

UL-AU Certificate

Certificate

UL-AU-230007 rev1

Issue date

2025-05-08

Expiration date

2034-07-29



www.jasanz.org/register

This is to acknowledge that

Hilti (Aust.) Pty. Ltd

1G Homebush Bay Drive, PO Box 3217, Rhodes, NSW 2138, Australia

has had

Firestopping Sealant

Model(s):

Hilti CFS-TTS E Firestop Top Track Seal

evaluated and meets the requirements of the standard(s)

AS 1530.4:2014 and AS 4072.1:2005

The designated Certificate Holder is entitled to use the UL-AU Mark for the Certified Product manufactured at the production site(s) identified on page 2, in accordance with the UL-AU Mark Scheme Service Agreement. Only those Products bearing the UL-AU Mark for Australia should be considered as being covered by UL's UL-AU Mark Service.

A blue ink signature of Stuart Foster.

Stuart Foster (Certification Officer)

Certification Body:

UL International New Zealand Limited,
54 Tarndale Grove, Albany, Auckland 0632, New Zealand.

All dates are in Year-Month-Day format (YYYY-MM-DD).

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Listing Category and File Ref: AUED.RS5418

Certification Marking: The UL-AU mark shall appear on certified products only and shall be used only in accordance with the UL-AU Mark Scheme Service Terms

Minimum size is not specified, as long as the Mark is legible

The following Supplementary Information shall be placed adjacent to the Certification Mark;

Firestopping - Intumescent Seals and Fire Pillows

AS 1530.4

Manufacturer: Hilti AG,

Feldkircherstrasse 100, FL-9494 Schaan, Liechtenstein Internet: www.hilti.com

Production Sites (Factory): Hilti Plant 4a

Trade Name or Trademark:

Hilti CFS-TTS E Firestop Top Track Seal

Model Details:

Hilti CFS-TTS E Firestop Top Track Seal

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Additional Information:

Details of revision: UL-AU certificate template form updated. All information transferred to new form.

This certificate is evidence that prototypes of the nominated products and their configurations as detailed in Appendix A conform to the following parameters:

1. Have been tested to AS 1530.4:2014 and AS 4072.1:2005 or an equivalent or more severe test and the Fire Resistance Level (FRL) nominated in Appendix A was achieved by the prototype for each nominated assembly of service penetration, building element and protection method configuration, without the assistance of an active fire suppression system.

2. Test results are detailed in a confidential test report that may be available from the certificate holder upon request. The information regarding the test parameters is included in the confidential technical file.

(i) the method and conditions of the test;

(ii) form of construction of the tested prototype; and

(iii) that restraint complied with AS 1530.4.

3. Testing was conducted at multiple locations by suitably accredited laboratories that are accredited by a signatory to the International Accreditation Cooperation Mutual Recognition Arrangement (ILAC-MRA) as recognised by NATA who is also a signatory body to this Agreement. The data has been reviewed by UL against the relevant to accreditation schedules.

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Appendix A

Conforming product configurations to achieve nominated FRL's

A.1 Hilti CFS-TTS E Firestop Top Track Seal:

Hilti CFS-TTS E Firestop Top Track Seal is supplied in lengths packed in cardboard boxes.

CFS-TTS E is available in 50 (E5), 62 (E6), 74 (E7) and 95 (E9) mm in width fitting to different steel track sizes.

CFS-TTS ES is available for use in replacement of all plasterboard wall steel top track sizes mentioned above and for double stud installation, which correspond to ES with tear line in the mid of back and two strips of adhesion ribbon at the inner edges of the back to ease installation on track (see also Annex B, picture 1).

Technical product literature:


Technical Data Sheet Hilti CFS-TTS E Firestop Top Track Seal

RESISTANCE TO FIRE CLASSIFICATION AND USE CATEGORIES FOR DRYWALL PARTITIONS USING HILTI CFS-TTS E FIRESTOP TOP TRACK SEAL

A.1.1 Specific characteristics for floor / ceiling base material

Rigid floors: The solid floor/ceiling (E) must have a minimum thickness $t_E \geq 100$ mm and comprise of concrete with a density of about 2400 kg/m^3 .

A.1.1.1 Metal deck floors: Maximum height of deck profile is 65 mm. Overall area restricted to 0.00957 m^2 for each profile

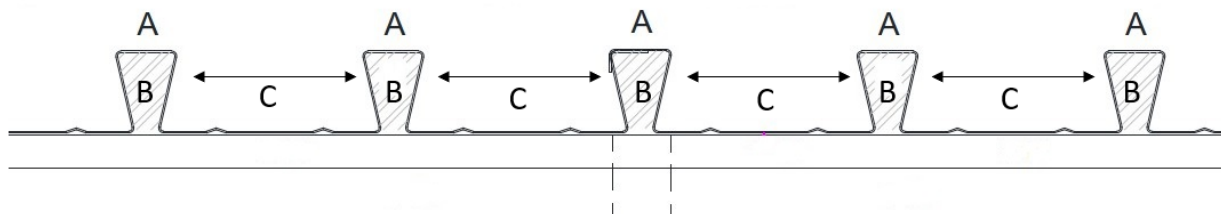

A- Metal decking profile

B- Metal decking filled with 10 mm depth of Hilti CP606. Cavity backfilled with insulation

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

A.1.1.2 Standard flexible wall construction

FRL -/60/60 Standard flexible wall construction

The wall must have a minimum thickness of 90 mm and consisted of steel stud framing (minimum 64 mm) lined on both faces with minimum of 1 layer of 13 mm thick fire grade plasterboard and must be tested to achieve an FRL of -/60/60 or 60/60/60. The plasterboard construction can occasionally include 2 layers of 13 mm thick fire grade plasterboard in one of the faces.

FRL -/90/90: The wall must have a minimum thickness of 96 mm and consisted of steel stud framing (minimum 64 mm) lined on both faces with minimum of 1 layer of 16 mm thick fire grade plasterboard and must be tested to achieve an FRL of -/90/90 or 90/90/90.

FRL -/120/120: The wall must have a minimum thickness of 116 mm and consisted of steel stud/timber framing (minimum 64 mm for steel, 70 mm for timber) lined on both faces with minimum of two layers of 13 mm or 16 mm thick fire grade plasterboard and must be tested to achieve an FRL of -/120/120 or 120/120/120.

For all plasterboard system described above, fire rated gypsum plaster boards can optionally be Knauf Firestop, CSR Gyprock Fyrchek, Siniat Fireshield, GIB Fyreliner, BGC Fireboard / GTEK Fire, Elephant Plasterboard and Midland Fire- Resistant Plasterboard. All plasterboard system shall be tested or assessed to AS 1530.4 and achieve described FRL.

A.1.2 Wall Cavity Insulation

For all plasterboard system described in A.1.1, Wall cavity insulation can optionally be Bradford Acoustigard, GreenStuf, Pink Batts, Earthwool or similar insulation with same thickness, density and R value as stipulated below.

Thickness shall be minimum 50 mm
R Value shall be R1.2 or higher

A.1.3 Fasteners of top / deflection head track

X-X 27 MX / P8, X-C 20 MX, X-C 22 P8 S15-TH, X-C 20 B3, X-C 20 B3 MX, X-P 17 B3 MX, X- P 20 B3 MX, X-P 24 B3 MX, X-P 17 G3, X-P 17 G3 MX, X-P 20 G3 MX, X-GN 20 MX, X-GHP 18 MX, HUS3-P/H 6 x 35 and deeper embedment, HUS3-P/H 8 (Range), HUS3-P/H 10 (Range), DBZ 6/4.5, HFB 6 x 35 and deeper embedment or equivalent

“For the fixing of partition wall tracks and deflection heads in seismic-relevant applications and/or cracked concrete, the Hilti X-X 27MX / P8 nail has been tested and recommended.”

A.2 Top of wall seal - installation specifics

Hilti CFS-TTS E Firestop Top Track Seal is applied on the topside on dry walls. It is placed on the upper horizontal top track/deflection head track, along the entire width of the wall. The (gypsum plasterboard) lining is fixed onto the vertical studs, compressing (a minimum) of 11 mm of the Hilti CFS-TTS E Firestop Top Track Seal, leaving a top joint of maximum 30 mm width depending on movement indication.

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

The gap will accommodate the incidental movement of the ceiling relative to the wall.


Nominal gap width (W): up to 20 mm;

Table 1: CFS TTS E size selection table

CFS TTS E is manufactured fit track width for easy installation, any larger CFS TTS E size if taped or folded to fit the top track can achieve the designated FRL, table below suggests most suitable CFS TTS E size according to the track size

Track config and size	Hilti CFS-TTS E FIRESTOP Top Track Seal Size
64-65 mm	Firestop top track seal CFS-TTS E6 OR Firestop top track seal CFS-TTS ES
71-77 mm	Firestop top track seal CFS-TTS E7 OR Firestop top track seal CFS-TTS ES
92-98 mm	Firestop top track seal CFS-TTS E9 OR Firestop top track seal CFS-TTS ES
150 mm	Firestop top track seal CFS-TTS ES
double stud walls (single stud size as above)	Firestop top track seal CFS-TTS ES

General construction details:

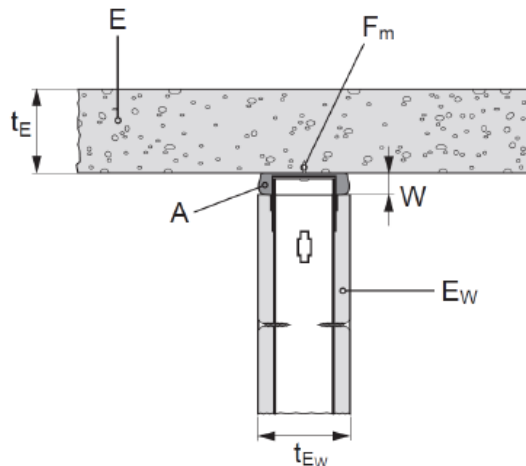

- A = Hilti Fire Stop Product CFS-TTS E
- E = ceiling; concrete according to Annex A.1.1.1 or Annex A.1.1.1
- E_w = flexible wall according Annex A.1.1.2, A.1.2
- F_m = Material/anchors to fix track to concrete ceiling according Annex A.1.3 (see specific application)
- t_E = thickness of concrete slab
- W = maximal top joint width

Stud and top track flanges are overlapping but are not fixed to each other. Also refers to plasterboard manufacturer installation details

Splices by CFS-TTS E pieces are allowed. At each splice a compression should be considered corresponding to an extra length of CFS-TTS E of 13 mm/3 m (see also Appendix B, picture 2, 4)

UL-AU Certificate


Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

A.3 Specific description of Drywall partitions using Hilti CFS-TTS E Firestop Top Track Seal

A.3.1 Hilti CFS TTS E in top of wall joint in flexible wall construction with concrete floor

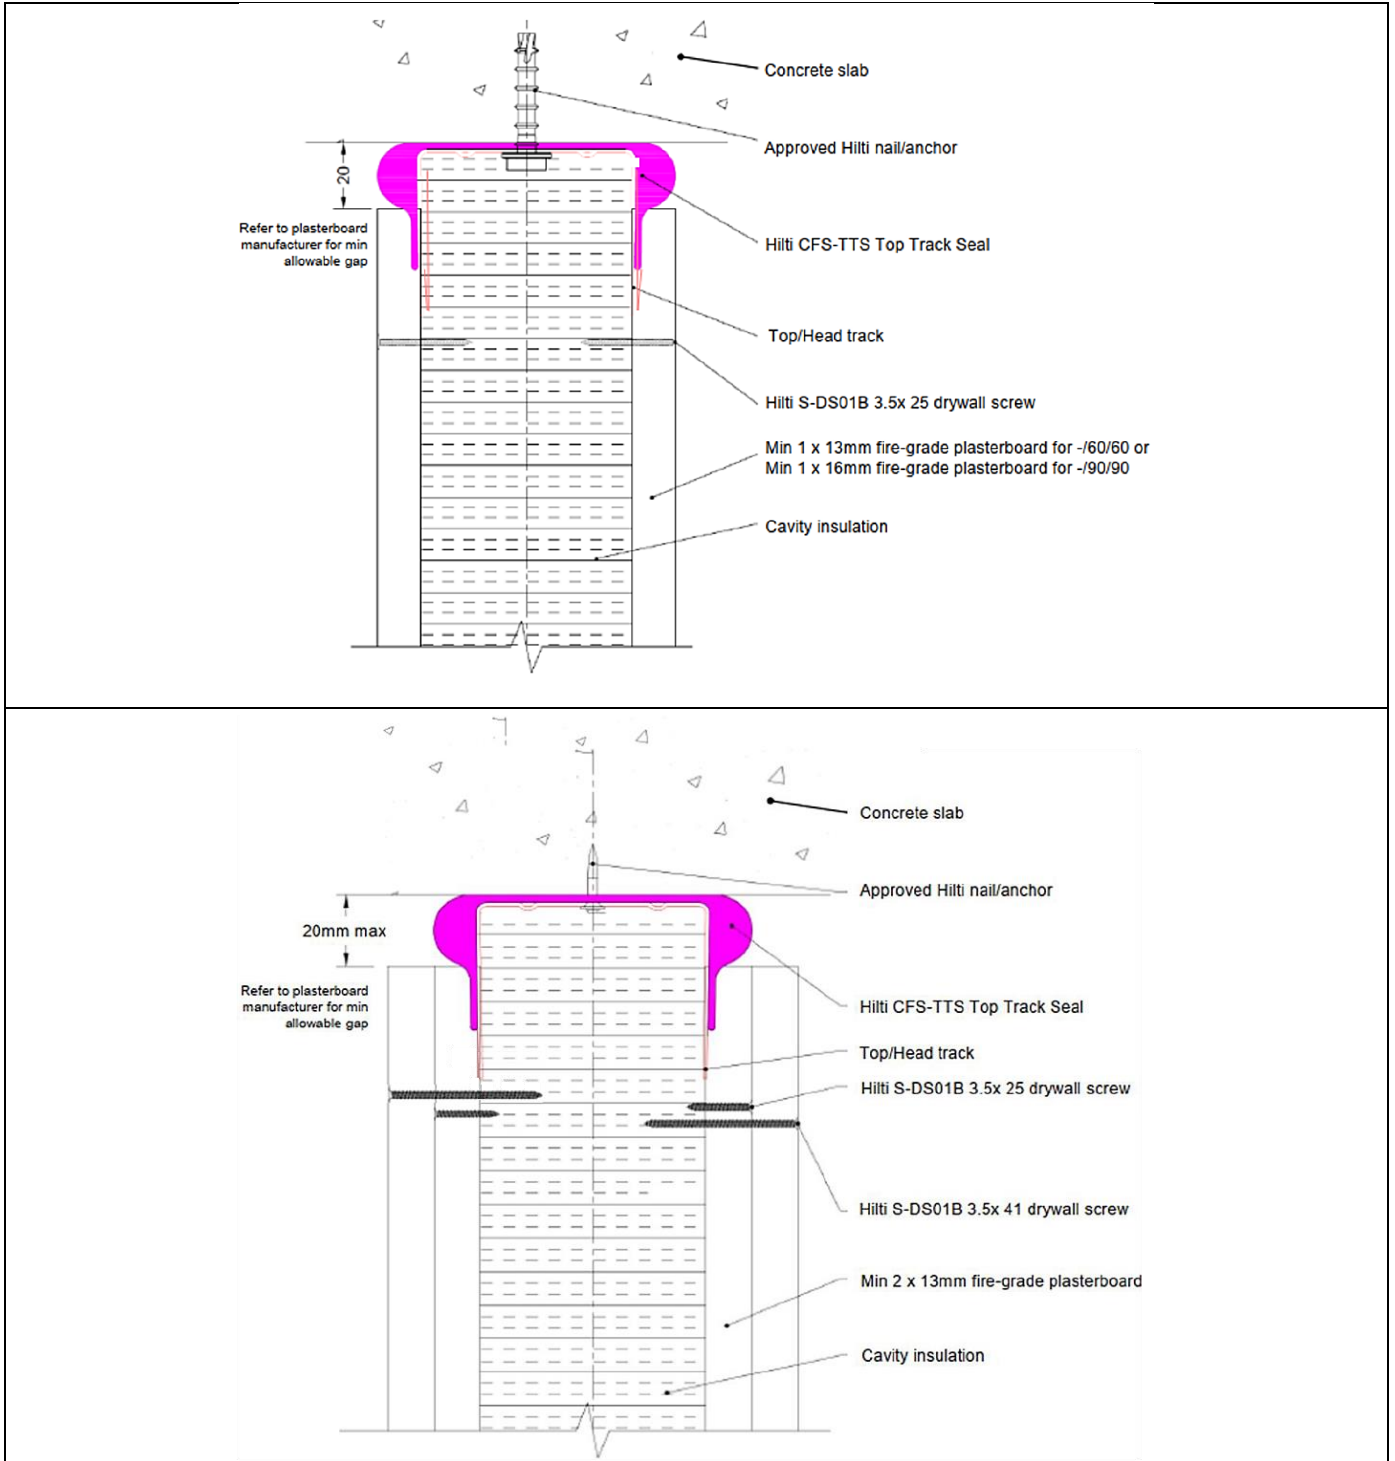


UL-AU Certificate

Certificate No: UL-AU-230007 rev1
Original Date of Certification: 2024-07-29
Date of Revision: 2025-05-08


CFS TTS E corner details

Top/Head track

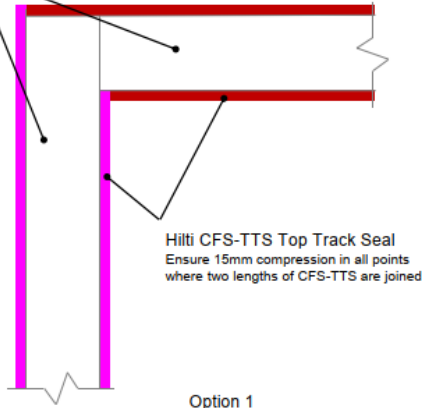


Option 1

Top/Head track

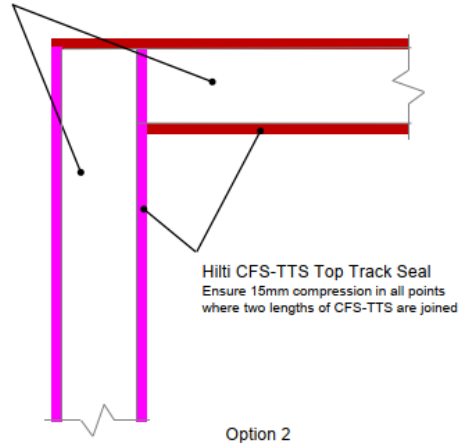


Option 2

CFS TTS E T-joint details

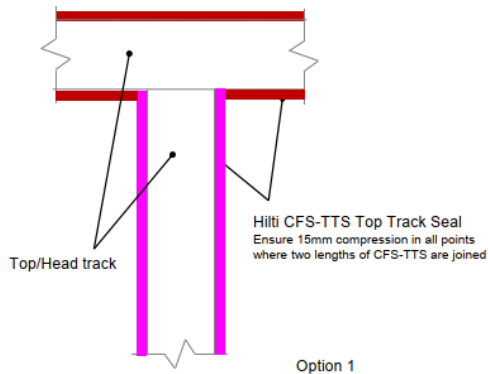


Option 1

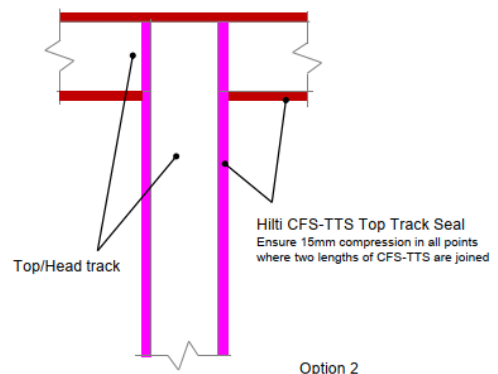

Option 2

CFS TTS E around deep beam installation

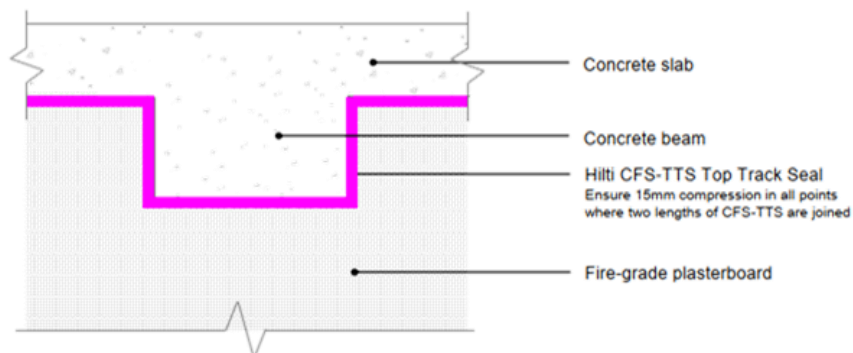

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Track size	Maximum top joint width	Top Track Fasteners	Hilti CFS TTS E top track seal	Joint construction	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	Min. 64 mm as per Table 1: CFS TTS E size selection table in Section A.2	20 mm	Refers to A.1.3 Fasteners of top / deflection head track	Firestop top track seal CFS-TTS E6* Firestop top track seal CFS-TTS E7* Firestop top track seal CFS-TTS E9* Firestop top track seal CFS-TTS ES* as per Table 1: CFS TTS E size selection table in Section A.2	Horizontal, corners, T-joints, around deep beam	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall						-/90/90
Min. 116 mm (min. 2 x 13 mm) or min. 128 mm (min. 2 x 16 mm) plasterboard wall						-/120/120

* As per Table 1: CFS TTS E size selection table in Section A.2

Hilti CFS TTS E can be used in conjunction with Hilti CP 606 when needed following this certificate and latest CP 606 UL certificate


UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

A.3.2 Hilti CFS TTS E in top of wall joint in flexible wall construction with metal decking

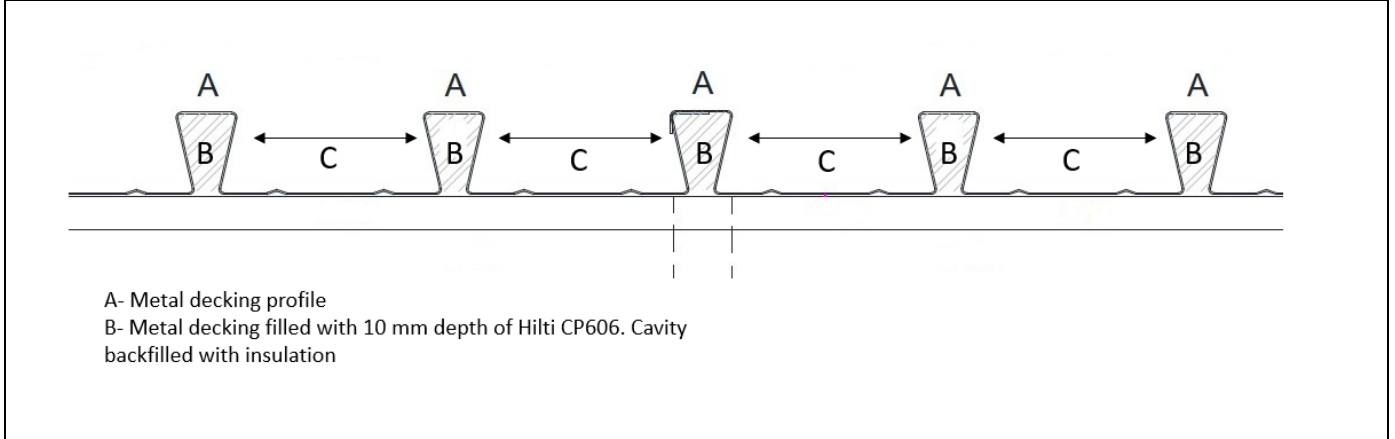

Separating element (minimum thickness)	Track size	Maximum joint width	Top track Fasteners	Hilti CFS TTS E top track seal	Metal deck dimension	Metal deck sealing	FRL*
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	64-65 mm	20 mm	Refers to A.1.3 Fasteners of top / deflection head track	Firestop top track seal CFS-TTS E6*	Maximum metal deck profile height 65 mm. seal area within the profile is restricted to 0.00957 m ²	Hilti CP606 ,10 mm deep on both sides. Cavity backfilled with mineral rockwool insulation (density 100 kg/m ³)	-/60/60**
	71-77 mm			Firestop top track seal CFS-TTS E7*			
	92-98 mm			Firestop top track seal CFS-TTS E9*			
	≥92 mm single stud or double stud walls with total track width ≥92 mm			Firestop top track seal CFS-TTS ES*			

#This table is applicable if the wall is perpendicular to the metal decking. If the wall is parallel to the decking, listed FRLs are applicable without the necessity of "Metal deck profile sealing". The width between the decking (indicated as C in Figure 7) must be greater than the thickness of the wall. The wall must be installed in between the decking profile (within C section) and the head track and the CFS TTS E must not be exposed to the metal decking profile cavity.

* CFS TTS E size refers to A.2 Table 1: CFS TTS E size selection table

Hilti CFS TTS E can be used in conjunction with Hilti CP 606 when needed following this certificate and latest CP 606 UL certificate

**Any CFS TTS E type

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Track size	Maximum joint width	Top track Fasteners	Hilti CFS TTS E top track seal	Metal deck dimension	Metal deck sealing	FRL#
Min. 96 mm (min. 1 x 16 mm) or min. 116 mm (min. 2 x 13 mm) plasterboard wall	64-65 mm	20 mm	Refers to A.1.3 Fasteners of top / deflection head track	Firestop top track seal CFS- TTS E6*	Maximum metal deck profile height 65 mm. seal area within the profile is restricted to 0.00957 m ²	Hilti CP606 ,10 mm deep on both sides. Cavity backfilled with mineral rockwool insulation (density 100 kg/m ³)	-/60/60
	71-77 mm			Firestop top track seal CFS- TTS E7*			-/90/90
	92-98 mm			Firestop top track seal CFS- TTS E9*			
	≥92 mm single stud or double stud walls with total track width ≥92 mm			Firestop top track seal CFS- TTS ES*			

#This table is applicable if the wall is perpendicular to the metal decking. If the wall is parallel to the decking, listed FRLs are applicable without the necessity of "Metal deck profile sealing". The width between the decking (indicated as C in Figure 7) must be higher than the thickness of the wall. The wall must be installed in between the decking profile (within C section) and the head track and the CFS TTS E must not be exposed to the metal decking profile cavity.


* CFS TTS E size refers to A.2 Table 1: CFS TTS E size selection table in Section

Hilti CFS TTS E can be used in conjunction with Hilti CP 606 when needed following this certificate and latest CP 606 UL certificate

UL-AU Certificate

Certificate No: UL-AU-230007 rev1
Original Date of Certification: 2024-07-29
Date of Revision: 2025-05-08

A.3.3 Hilti CFS TTS E in top of wall joint in flexible wall construction with uneven horizontal surfaces

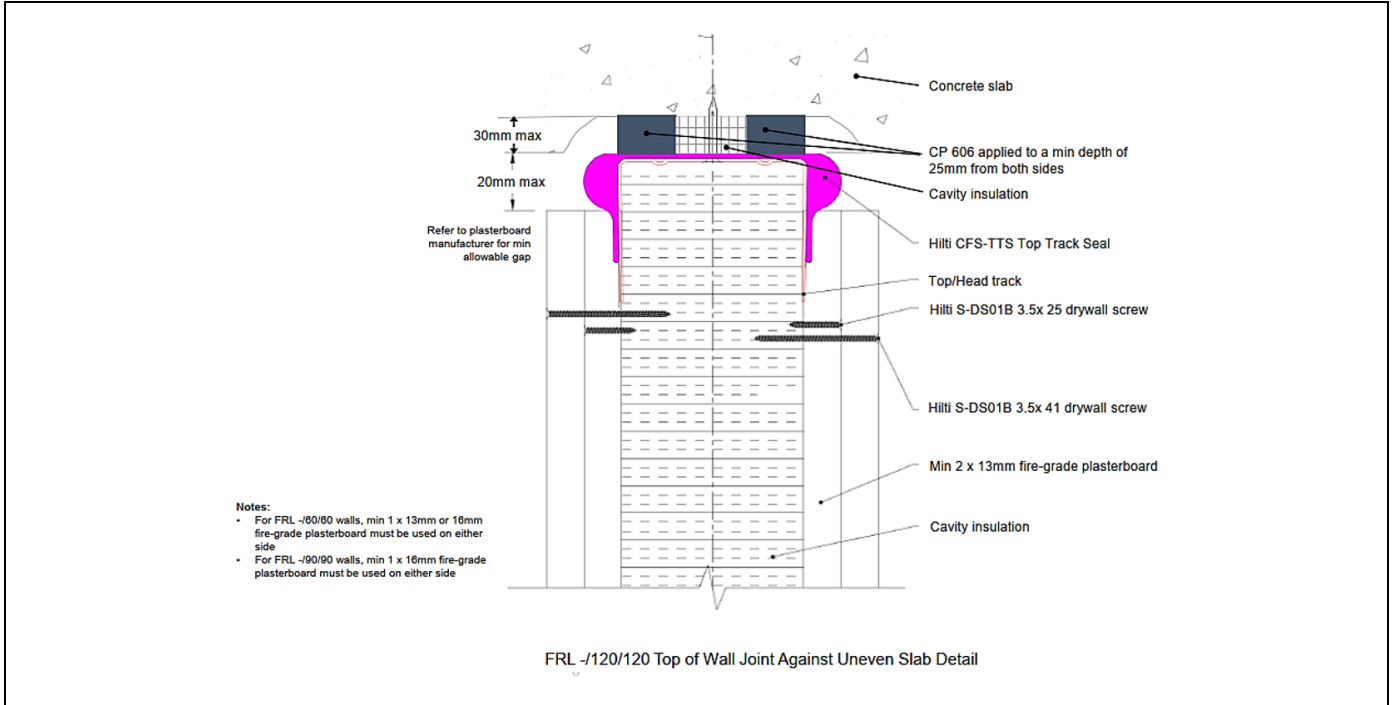

Separating element (minimum thickness)	Track size	Maximum top joint width	Top track Fasteners	Maximum allowable overhead gap	Hilti CFS TTS E top track seal	Sealing system	FRL*
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	Min. 64 mm as per Table 1: CFS TTS E size selection table in Section A.2	20 mm	Refers to A.1.3 Fasteners of top / deflection head track	30 mm	Firestop top track seal CFS-TTS E6*	Hilti CP606 25 mm deep. The cavity backfilled with mineral rockwool insulation (density 100 kg/m ³)	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall					Firestop top track seal CFS-TTS E7*		-/90/90
Min. 116 mm (min. 2 x 13 mm) plasterboard wall					Firestop top track seal CFS-TTS E9* Firestop top track seal CFS-TTS ES*		-/120/120

* As per Table 1: CFS TTS E size selection table in Section A.2

Hilti CFS TTS E can be used in conjunction with Hilti CP 606 when needed following this certificate and latest CP 606 UL certificate

UL-AU Certificate


Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29


Date of Revision: 2025-05-08

A.3.4 Pipe penetrates through Hilti CFS TTS E in top of wall joint in flexible wall construction – metal pipes



A) Metal pipes passing through CFS TTS E without sealant coning.

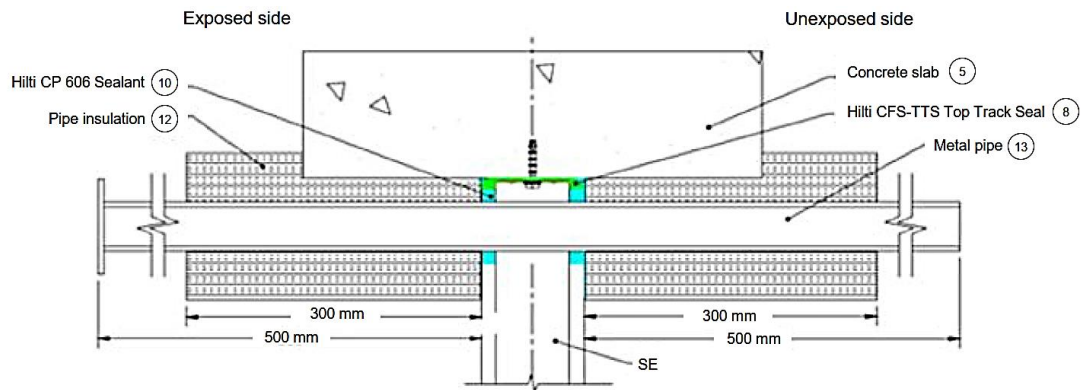

B) Metal pipes passing through CFS-TTS E with 50 mm x 50 mm CP 606 sealant coning for 90 and 120 minutes (as applicable) insulation performance

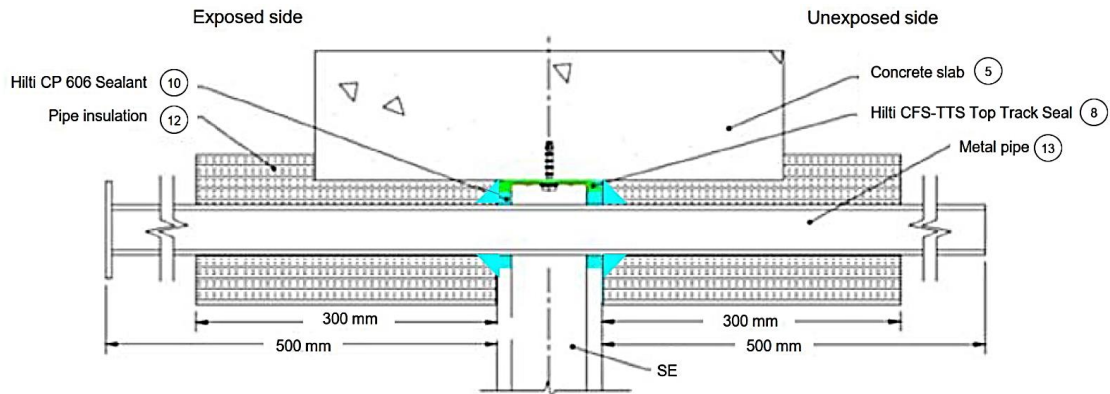

Track configurations

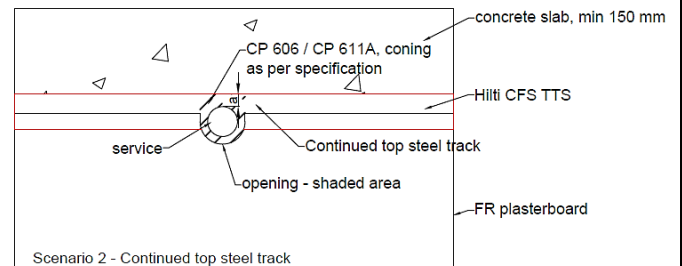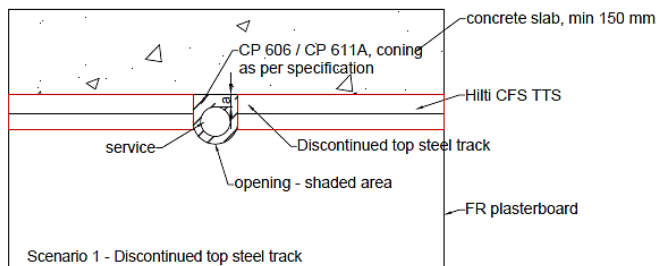

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Service	Aperture and annular gap	Sealant	Top track config	Insulation	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	Up to DN 40 mm dia. steel pipe as per AS 4118.2.1 and AS 2419 (Standard sprinkler pipe)	Maximum aperture 64 mm. Annular gap must not exceed 12 mm.	CP 606 to seal the annular gap as illustrated in Section A.3.4 A).	The service can either penetrate top track and CFS TTS E OR Top track can be stopped and start around service	38 mm thick mineral insulation up to 300 mm on each side (minimum nominal density 100 kg/m ³)	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall			CP 606 to seal the annular gap and application of 50 mm x 50 mm CP 606 in cone configuration around the service. The sealing details are illustrated in Section A.3.4 B).			-/90/90
Min. 116 mm (min. 2 x 13 mm) plasterboard wall						-/120/120

UL-AU Certificate

Certificate No: UL-AU-230007 rev1
Original Date of Certification: 2024-07-29
Date of Revision: 2025-05-08

Separating element (minimum thickness)	Service	Aperture and annular gap	Sealant	Top track config	Insulation	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	Up to DN20 mm copper pipe as per AS 1432 (Standard copper pipe)	Maximum aperture 48 mm. Annular gap must not exceed 14 mm.	CP 606 to seal the annular gap as illustrated in Section A.3.4 A).	The service can either penetrate top track and CFS TTS E OR Top track can be stopped and start around service	38 mm thick mineral insulation up to 300 mm on each side (minimum nominal density 100 kg/m ³)	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall			CP 606 to seal the annular gap and application of 50 mm x 50 mm CP 606 in cone configuration around the service. The sealing details are illustrated in Section A.3.4 B).			-/90/90
Min. 116 mm (min. 2 x 13 mm) plasterboard wall						-/120/120

UL-AU Certificate


Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29



Date of Revision: 2025-05-08

A.3.5 Pipe penetrates through Hilti CFS TTS E in top of wall joint in flexible wall construction – plastic pipes

A) Plastic pipes passing through CFS-TTS E without sealant coning.

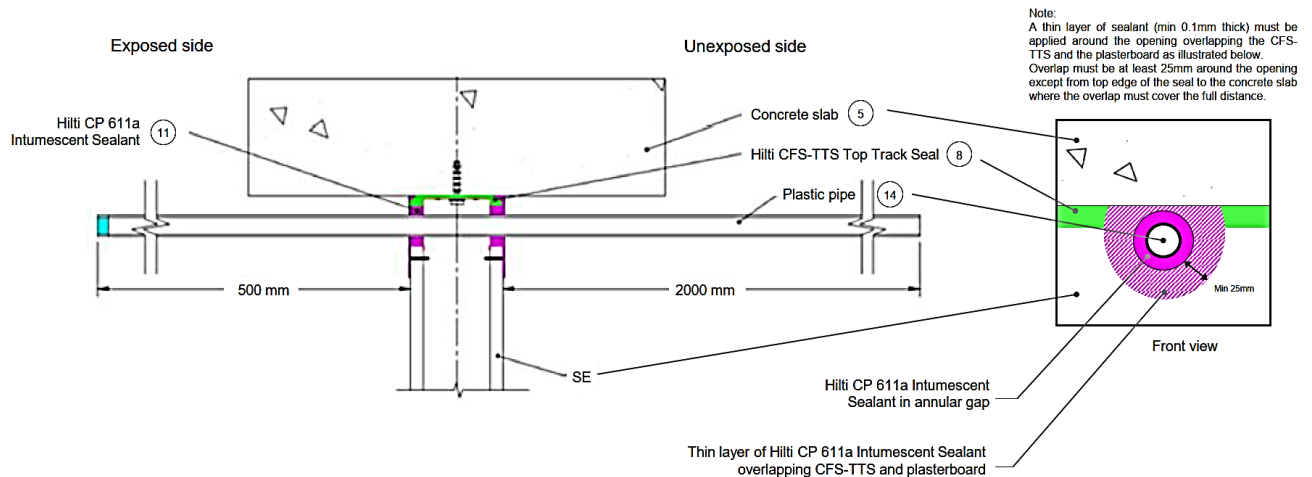

Track configurations

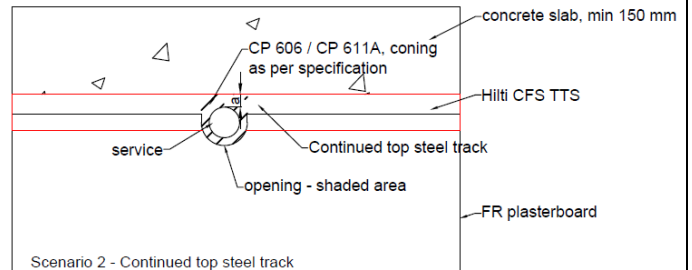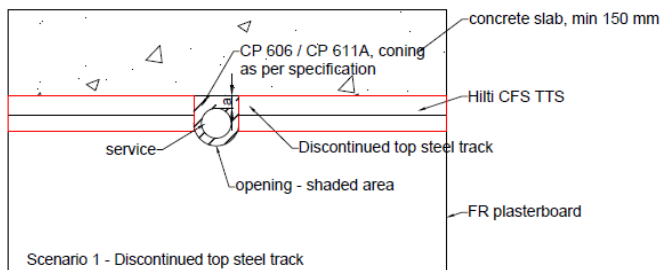

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Service*	Pipe Wall Thickness	Aperture and annular gap	Sealant	Top track config	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	16 mm Pex-a	Maximum 2.3 mm	Maximum aperture 38 mm. Maximum annular gap must not exceed 9 mm.	CP 611a to seal the annular gap as illustrated in Section A.3.5 A).	The service can either penetrate top track and CFS TTS E OR Top track can be stopped and start around service	-/60/60
	20 mm Pex-a					
	16 mm Pex-b					
	20 mm Pex-b					
Min. 96 mm (min. 1 x 16 mm) plasterboard wall	16 mm Pex-a/AI/Pex-a	Maximum 2.0 mm				-/90/60
	20 mm Pex-a/AI/Pex-a					
Min. 116 mm (min. 2 x 13 mm) plasterboard wall	16 mm Pex-b/AI/Pex-b					-/120/60
	20 mm Pex-b/AI/Pex-b					

*Services can be optionally positioned 5 mm or 0 mm from the seal edge

UL-AU Certificate


Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29


Date of Revision: 2025-05-08

A.3.6 Cable or cable bundles penetrates through Hilti CFS TTS E in top of wall joint in flexible wall construction



Single cable or cable bundles passing through Hilti CFS-TTS E without sealant coning.

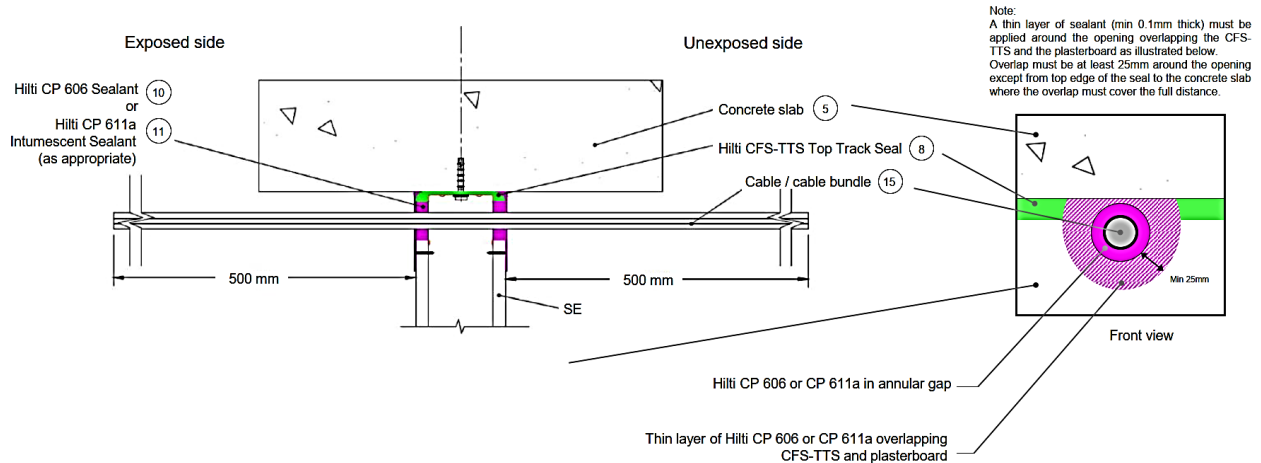

Single cable or cable bundle passing through Hilti CFS-TTS E with CP 606 and CP 611a (as appropriate) with 50 mm x 50 mm coning for 90 and 120 minutes (as appropriate) insulation performance.

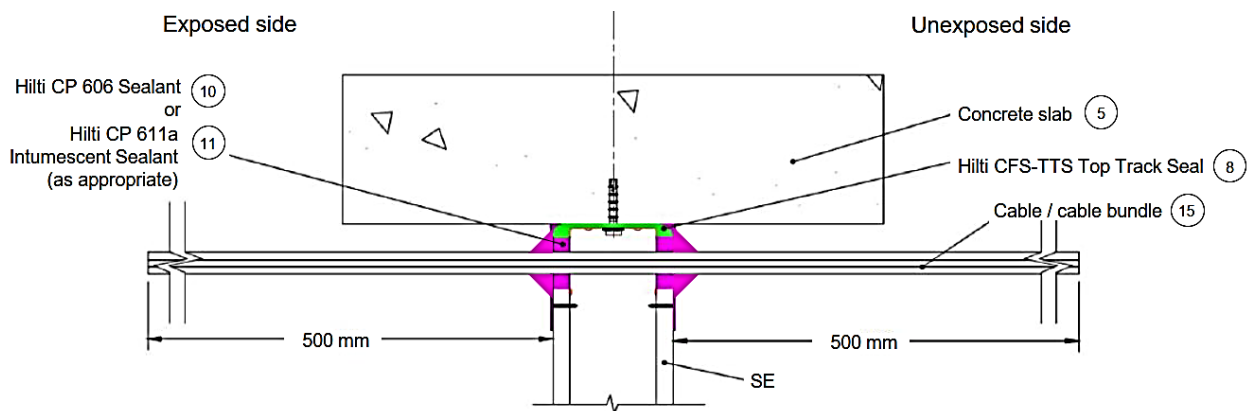

Track coningurations

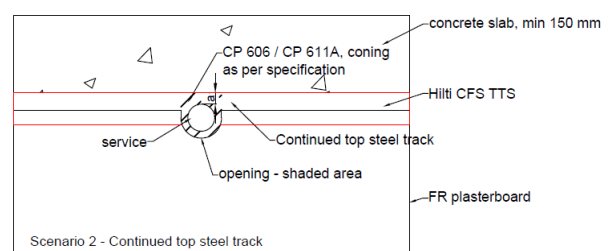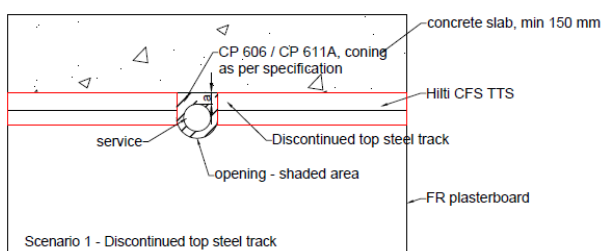

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Service*	Configuration	Cable details	Aperture and annular gap	Sealant	top track config	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	Electrical and communication cables including but not limited to circular submains, flat TPS, RG6 Quad Shield coax cables, data cables (CAT 5, 6, 7, 8), fire rated cables*	Single cable or in cable bundle	1.5 mm fire rated cable, 3 x CAT6 and 3 x RG6 cable bundle, 4 x 2.5 mm TPS cable bundle, 3 x 2.5 mm fire rated cable bundle or any other cable or cable bundle with maximum 30 mm ² conductor area (applicable to both single and multi-core cables)	Maximum Aperture 38 mm. Maximum annular gap must not exceed 14 mm.	CP 611a seal to the depth of plasterboard and finish flush	The service can either penetrate top track and CFS TTS E OR Top track can be stopped and start around service	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall					CP 611a to seal the annular gap. Additionally, CP 611a in 50 mm x 50 mm cone configuration around the service		-/90/90**
Min. 116 mm (min. 2 x 13 mm) plasterboard wall							- /120/90* *

*The cables could consist of copper conductors sheathed with PVC (if any) and insulated with either PVC or XLPE. The cable or cable bundle will be optionally positioned 0 mm from the seal edge.

**Sealant coning is only required when 90 minutes and 120 minutes of insulation performance is required.

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Service*	Configuration	Cable details	Aperture and annular gap	Sealant	top track config	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	Electrical and communication cables including but not limited to circular submains, flat TPS, RG6 Quad Shield coax cables, data cables (CAT 5, 6, 7, 8), fire rated cables*	Single cable or in cable bundle	3 x CAT6 cable bundle, 2 x 1.5 mm TPS cable bundle, 2 x RG6 cable bundle or any other cable or cable bundle with maximum 9 mm ² conductor area (applicable to both single and multi-core cables)	Maximum aperture 16 mm. Maximum annular gap must not exceed 3.5 mm.	CP 606 seal to the depth of plasterboard and finish flush	The service can either penetrate top track and CFS TTS E OR Top track can be stopped and start around service	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall							-/90/90
min. 116 mm (min. 2 x 13 mm) plasterboard wall							-/120/120

*The cables could consist of copper conductors sheathed with PVC (if any) and insulated with either PVC or XLPE. The cable or cable bundle will be optionally positioned 0 mm from the seal edge.

UL-AU Certificate


Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29


Date of Revision: 2025-05-08

A.3.7 Cable conduit penetrates through Hilti CFS TTS E in top of wall joint in flexible wall construction

Conduits with or without cable infill passing through Hilti CFS-TTS E with CP 606 and CP 611a (as appropriate) with 50 mm x 50 mm coning for 90 and 120 minutes (as appropriate) insulation performance..

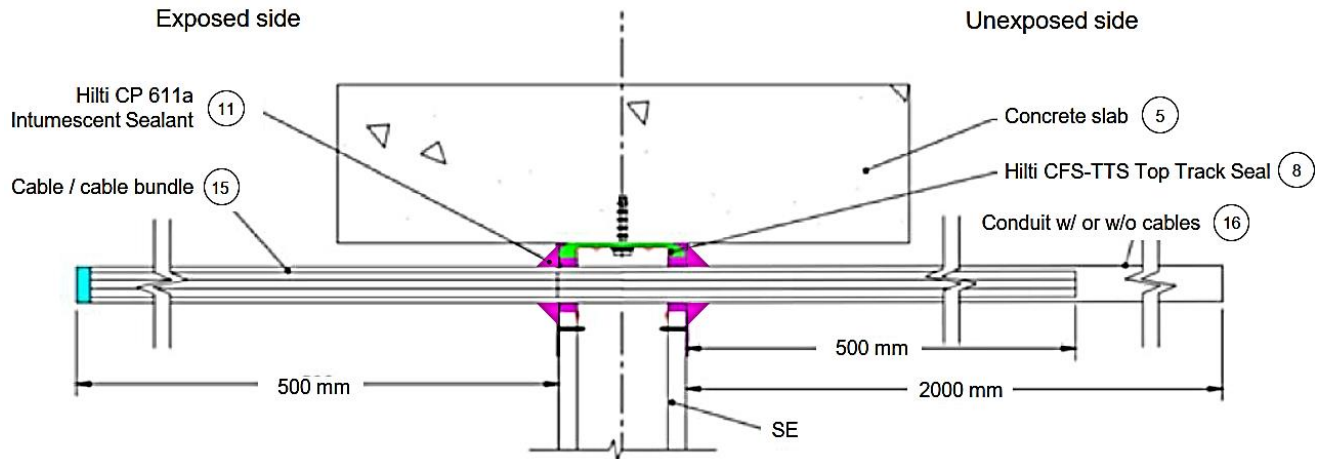

Track configurations

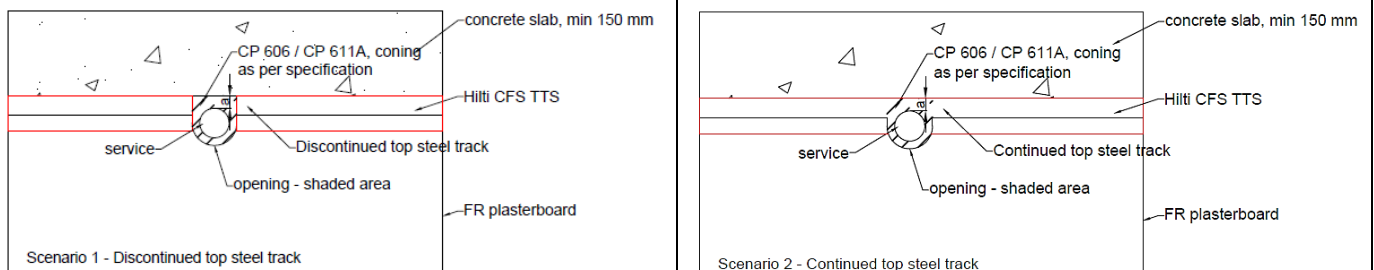

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Separating element (minimum thickness)	Service*	Conduit type	Cable in conduit*	Aperture and annular gap	Sealant	Top track config	FRL
Min. 90 mm (min. 1 x 13 mm) plasterboard wall or min. 103 mm (min. 1 x 13 mm on one side, min. 2 x 13 mm on the other) plasterboard wall	16 mm, 20 mm or 25 mm uPVC conduit*	Flexible or rigid	With or without cables. Cables could be 3 x CAT6 and 3 x RG6 cable bundle or any other cable or cable bundle with maximum conductor area of 2.4 mm ² (applicable to both single and multi-core cables).	Maximum Aperture 38 mm. Maximum annular gap must not exceed 6.5 mm.	CP 611a seal to the depth of plasterboard and finish flush	The service can either penetrate top track and CFS TTS E OR Top track can be stopped and start around service	-/60/60
Min. 96 mm (min. 1 x 16 mm) plasterboard wall					CP 611a to seal the annular gap. Additionally, CP 611a in 50 mm x 50 mm cone configuration around the service		-/90/90**
Min. 116 mm (min. 2 x 13 mm) plasterboard wall							-/120/120**

* The cables could be but not limited to circular submains, flat TPS, RG6 Quad Shield coax cables, data cables (CAT 5, 6, 7, 8), fire rated cables. The cables could consist of copper conductors sheathed with PVC (if any) and insulated with either PVC or XLPE.

**Sealant coning is only required when 90 minutes and 120 minutes of insulation performance is required.

UL-AU Certificate

Certificate No: UL-AU-230007 rev1


Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Appendix B

INSTALLATION OF THE PRODUCT AND ANCILLARY PRODUCT(S)

Installation of the Hilti CFS-TTS E Firestop Top Track Seal should be conducted as follows:

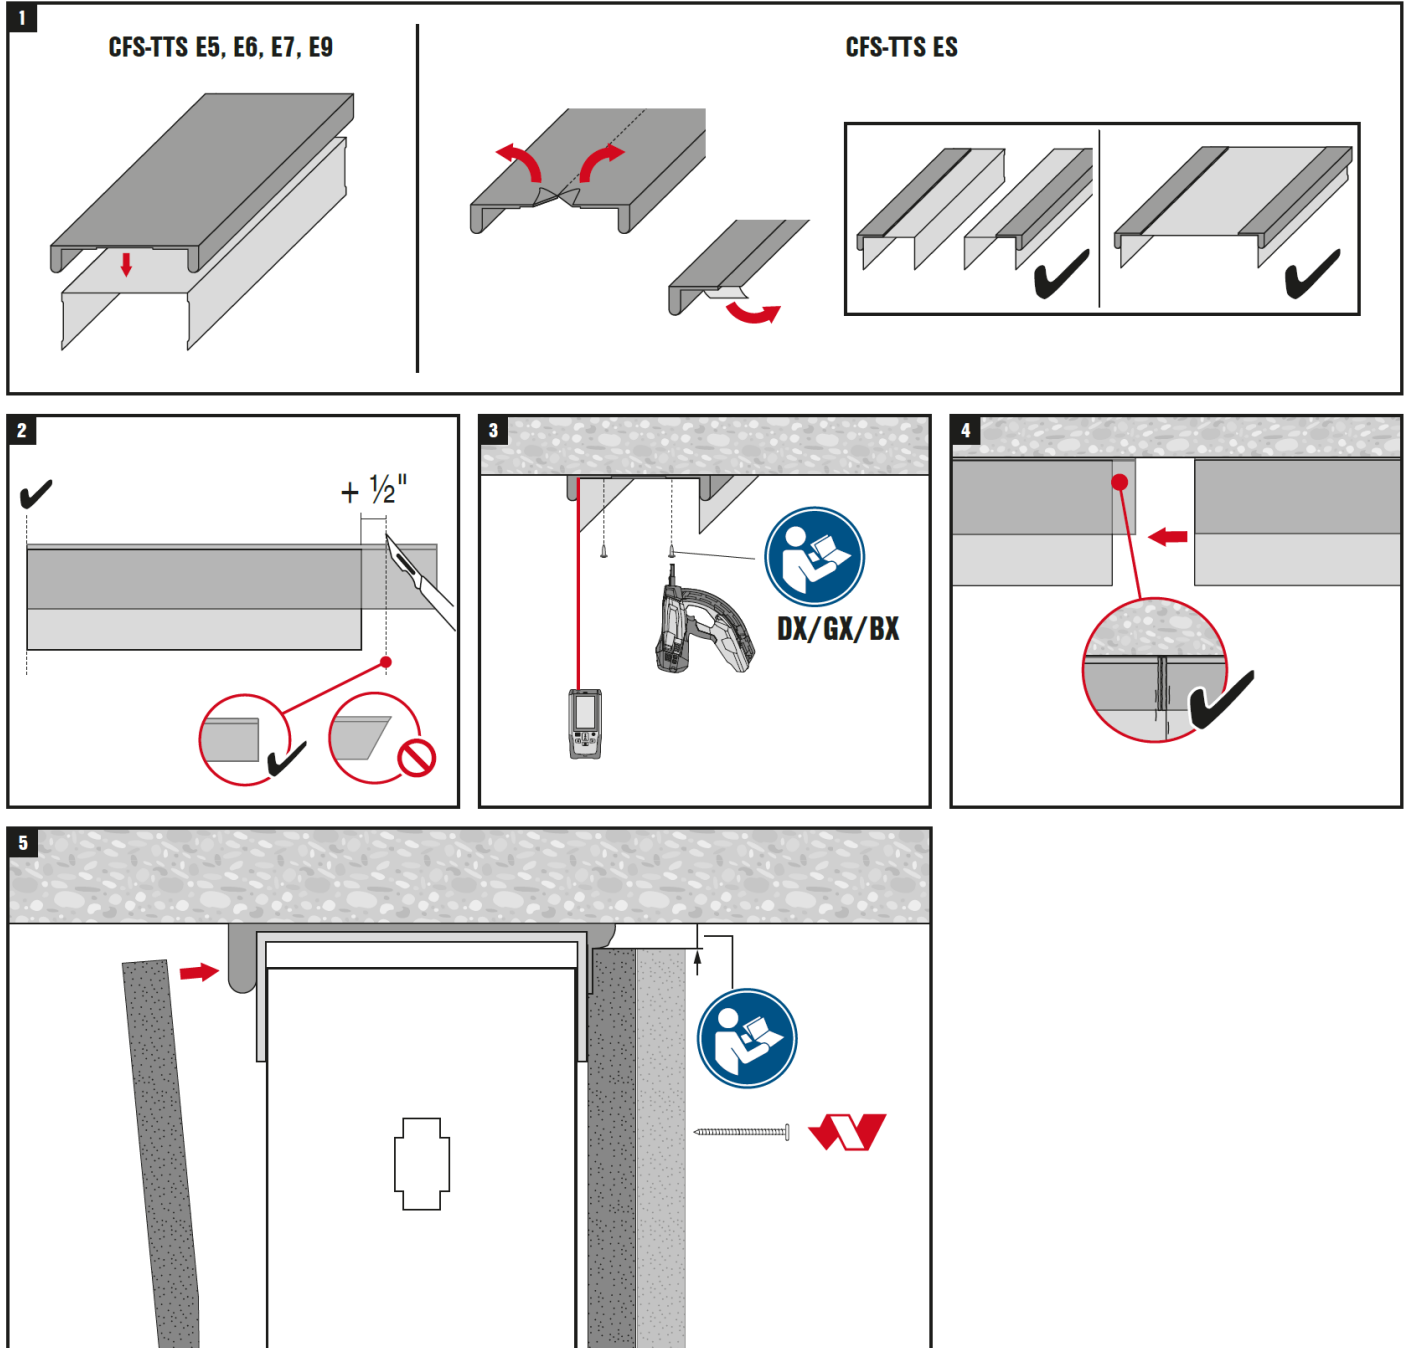

UL-AU Certificate

Certificate No: UL-AU-230007 rev1

Original Date of Certification: 2024-07-29

Date of Revision: 2025-05-08

Test Reports:

Name of Test Institute	Owner	Number of Report	Date of Test	Test standard
Exova Warringtonfire	HILTI Aust Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	EWFA 55905400.1 date 27.11.2018	24/07/2018	AS 1530.4-2014
Warringtonfire	HILTI Entwicklungsgesellschaft mbH Hiltistrasse 6, Kaufering 86916, Germany	WF 415429 date 07.11.2019	30/09/2019	prEN 1366-4: 2019 (E), July 2019
Warringtonfire	HILTI Entwicklungsgesellschaft mbH Hiltistrasse 6, Kaufering 86916, Germany	WF 415430 date 07.11.2019	30/09/2019	prEN 1366-4: 2019 (E), July 2019
Warringtonfire Australia Pty Ltd	HILTI (Australia) Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	FRT190406 R2.0 date 24.12.2019	21/11/2019	AS 1530.4-2014
Warringtonfire Australia Pty Ltd	HILTI (Australia) Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	FRT190438 date 31.12.2019	03/12/2019	AS 1530.4-2014
Warringtonfire Australia Pty Ltd	HILTI (Australia) Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	FRT200025 date 11.02.2020	11/05/2020	AS 1530.4-2014
Warringtonfire Australia Pty Ltd	HILTI (Australia) Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	FRT210149 R1.2 date 09/08/2021	18/06/2021	AS 1530.4-2014
Warringtonfire Australia Pty Ltd	HILTI (Australia) Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	FRT200338 R1.1 date 09/03/2021	25/11/2020	AS 1530.4-2014
Warringtonfire Australia Pty Ltd	HILTI (Australia) Pty Ltd 1G Homebush Bay Dr Rhodes NSW 2138	RIR FAS200132 R1.4 date 23/06/2021	n/a	n/a